



PREVIOUS

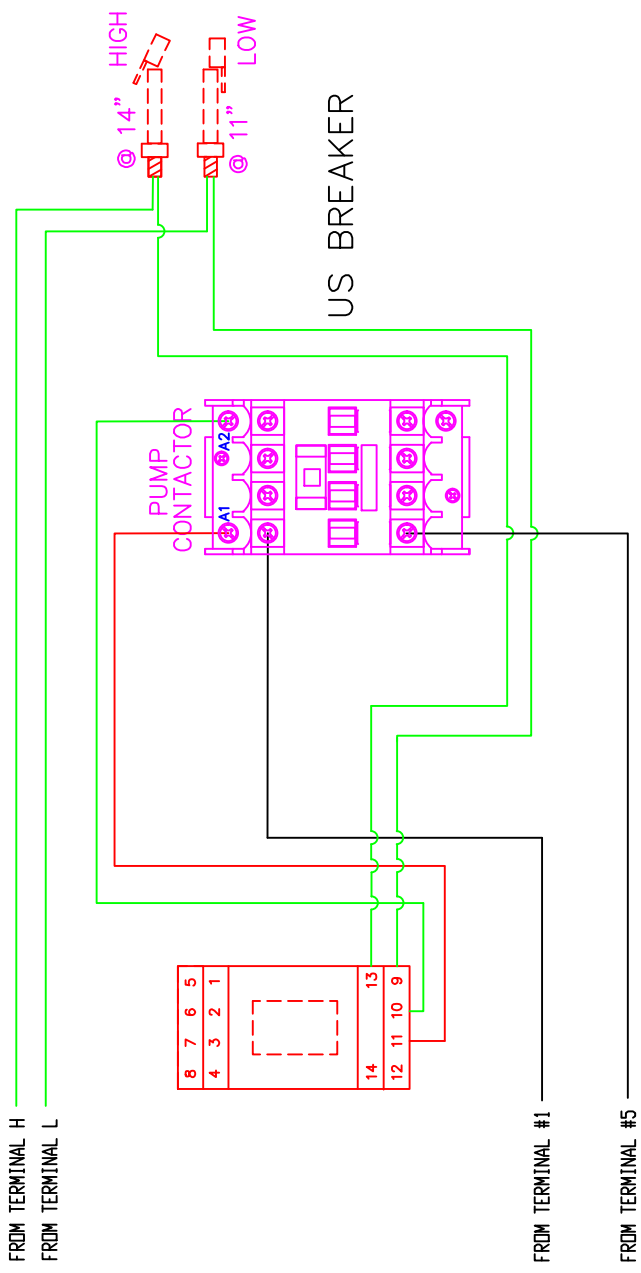

NEW

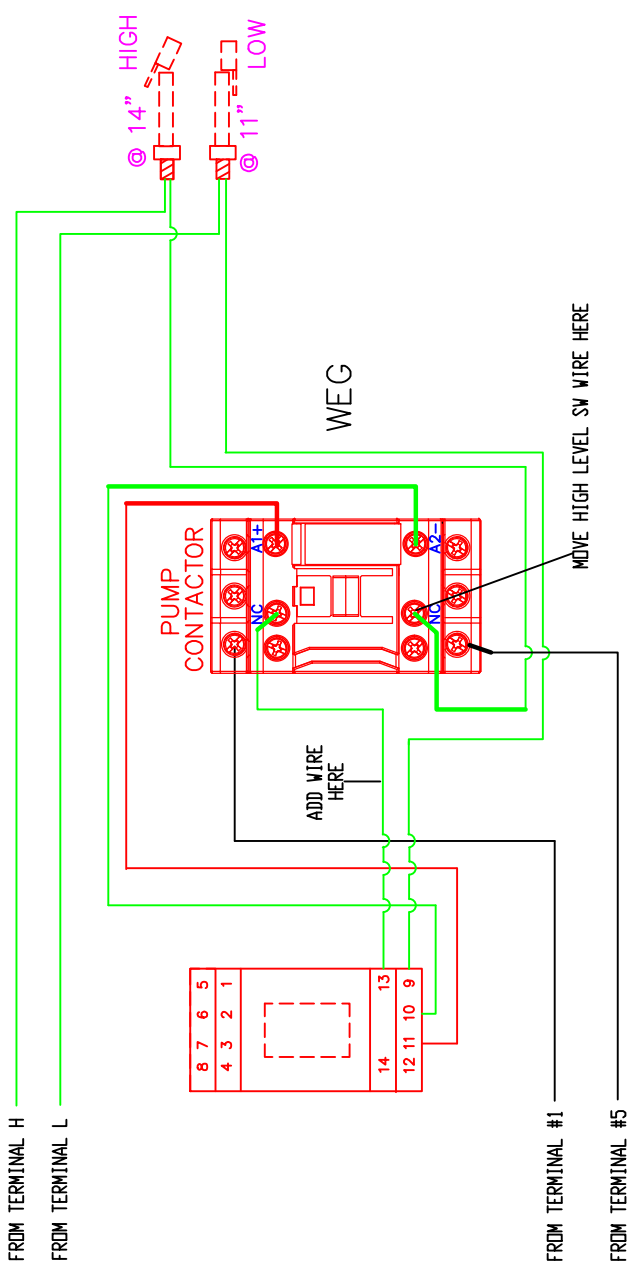

NOTES:

1. ADD A WIRE FROM TERMINAL #13 OF LATCHING RELAY TO THE TOP NC ON THE NEW CONTACTOR
2. WIRE FROM HIGH LEVEL SWITCH WILL MOVE TO BOTTOM NC ON THE NEW CONTACTOR

TITLE: AXIALL - CONTACTOR CHANGE FROM US BREAKER TO WEG OVERFLOW PROTECTION TERMINATION POINTS



DRAWN: SEH DATE: 9/9/2015

SCALE: 3/8" = 1'

CONTACTOR REPLACEMENT

REV

0